


EVO™ 200 AND EVO™ 400 AUTOMATIC TANK GAUGES

INSTALLATION GUIDE

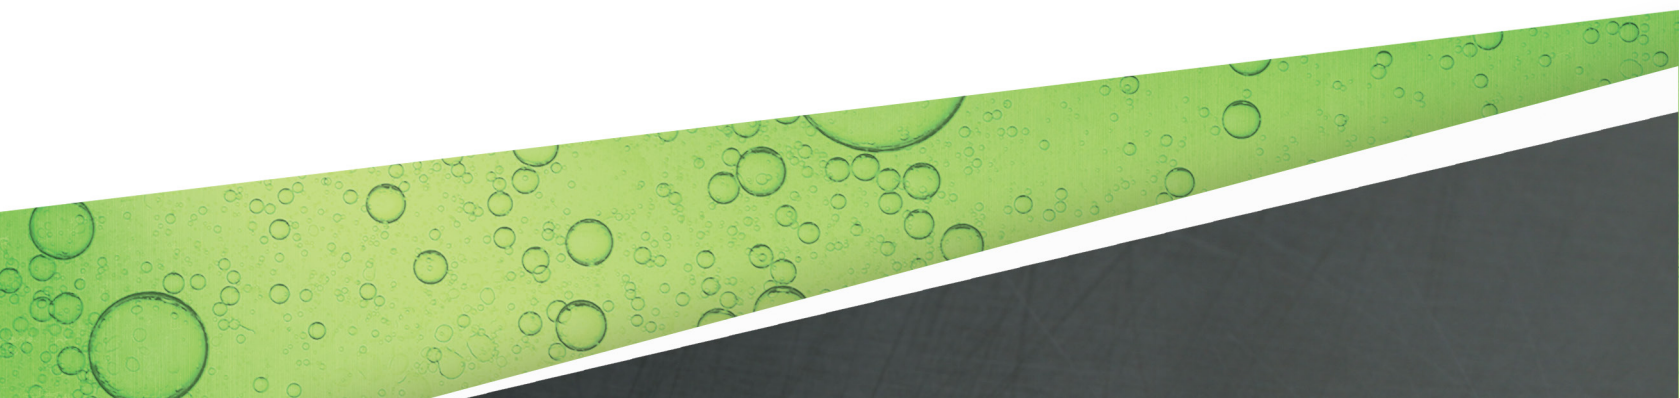

The information in this publication is provided for reference only. While every effort has been made to ensure the reliability and accuracy of the information contained in this manual at the time of printing, we recommend that you refer to “franklinfueling.com” for the most current version of this manual. All product specifications, as well as the information contained in this publication, are subject to change without notice. Franklin Fueling Systems does not assume responsibility and expressly disclaims liability for loss, damage, or expense arising out of, or in any way connected with, installation, operation, use, or maintenance by using this manual. Franklin Fueling Systems assumes no responsibility for any infringement of patents or other rights of third parties that may result from use of this manual or the products. We make no warranty of any kind with regard to this material, including, but not limited to, the implied warranties of merchantability and fitness for a particular purpose.

Copyright © 2019 Franklin Fueling Systems, LLC, Madison, WI 53718. All world rights reserved. No part of this publication may be stored in a retrieval system, transmitted, or reproduced in any way, including, but not limited to, photocopy, photograph, magnetic, or other record, without the prior written permission of Franklin Fueling Systems.

For technical assistance, please contact:

Franklin Fueling Systems
3760 Marsh Rd.
Madison, WI 53718
USA

Web: franklinfueling.com
Telephone:
USA and Canada: +1.608.838.8786, +1.800.225.9787
USA and Canada Technical Support: +1.800.984.6266
UK: +44 (0) 1473.243300
Mexico: 001.800.738.7610
China: +86.10.8565.4566

EVO is a trademark of Franklin Electric Company
Belden is a trademark of Belden Technologies, Inc.

228180003 r2

goind.com.au

Contents

Introduction	1
Questions and concerns	1
Conventions used in this manual	1
Operating precautions	2
Programming and operation documentation	3
Certified installer or service person	3
Station owner or operator	3
Abbreviations and acronyms	3
Product description	3
Specifications	4
Console Installation	5
Console location	5
Mounting the console	5
Removing the cover	5
Standard installation materials	6
Circuit breaker	6
Weatherproof junction boxes	6
Conduit	6
Splice connector kit warranty requirement	6
Moisture-resistant splice connectors	6
Thread sealant (UL classified)	6
Riser pipes	7
Cables required for liquid level probes and 4-20 mA sensors	7
Cable or wire for 2-wire sensors	7
Console dimensions	8
Wiring the console	9
Intrinsically safe wiring	9
Terms	9
UDP probe and sensor wiring	10
Line power wiring	11
Non-intrinsically safe wiring	11
Console power supply	11
Check electrical resistance to earth ground	12
110/240 VAC line power wire connections	12
Console Ground Connection	12
Communication ports	12
RS-232 communication connectors	13

RS-485 communication connectors	13
Relay wiring.....	14
Dry contacts.....	14
Control drawing 1	15
Control drawing 2	16



Introduction

This manual contains installation instructions for the Franklin Fueling Systems (FFS) EVO™ 200 and EVO™ 400 Automatic Tank Gauges (ATGs). You must follow all safety information, warnings, instructions, and other information in this manual. Please read this entire manual carefully. If you do not follow the instructions in this manual, the result could be faulty operation, equipment damage, injury, or death.

Questions and concerns

In case of emergency, follow the procedures established by your facility. If you have questions or concerns about safety or need assistance, use the information below to contact FFS:

Web: franklinfueling.com

Telephone:

USA and Canada: +1.608.838.8786, +1.800.225.9787

USA Technical Support: 1.800.984.6266

UK: +44 (0) 1473.243300

Mexico: 001.800.738.7610

China: +86.10.8565.4566

Conventions used in this manual

This manual includes safety precautions and other important information presented in the following format:

NOTE: This provides helpful supplementary information.

IMPORTANT: This provides instructions to avoid damaging hardware or a potential hazard to the environment, for example: fuel leakage from equipment that could harm the environment.

⚠ CAUTION: This indicates a potentially hazardous situation that could result in minor or moderate injury if not avoided. This may also be used to alert against unsafe practices.

⚠ WARNING: This indicates a potentially hazardous situation that could result in severe injury or death if not avoided.

⚠ DANGER: This indicates an imminently hazardous situation that will result in death if not avoided.

Operating precautions

FFS equipment is designed to be installed in areas where volatile liquids such as gasoline and diesel fuel are present. Working in such a hazardous environment presents a risk of severe injury or death if you do not follow standard industry practices and the instructions in this manual. Before you work with or install the equipment covered in this manual, or any related equipment, read this entire manual, particularly the following precautions:

IMPORTANT: To help prevent spillage from an underground storage tank, make sure the delivery equipment is well-maintained, that there is a proper connection, and that the fill adaptor is tight. Delivery personnel should inspect delivery elbows and hoses for damage and missing parts.

⚠ CAUTION: Use only original FFS parts. Substituting non-FFS parts could cause the device to fail, which could create a hazardous condition and/or harm the environment.

⚠ WARNING: Follow all codes that govern how you install and service this product and the entire system. Always lock out and tag electrical circuit breakers while installing or servicing this equipment and related equipment. A potentially lethal electrical shock hazard and the possibility of an explosion or fire from a spark can result if the electrical circuit breakers are accidentally turned on while you are installing or servicing this product. Refer to this manual (and documentation for related equipment) for complete installation and safety information.

⚠ WARNING: Before you enter a containment sump, check for the presence of hydrocarbon vapors. Inhaling these vapors can make you dizzy or unconscious, and if ignited, they can explode and cause serious injury or death. Containment sumps are designed to trap hazardous liquid spills and prevent environmental contamination, so they can accumulate dangerous amounts of hydrocarbon vapors. Check the atmosphere in the sump regularly while you are working in it. If vapors reach unsafe levels, exit the sump and ventilate it with fresh air before you resume working. Always have another person standing by for assistance.

⚠ WARNING: Follow all federal, state, and local laws governing the installation of this product and its associated systems. When no other regulations apply, follow NFPA codes 30, 30A, and 70 from the National Fire Protection Association. Failure to follow these codes could result in severe injury, death, serious property damage, and/or environmental contamination.

⚠ WARNING: Always secure the work area from moving vehicles. The equipment in this manual is usually mounted underground, so reduced visibility puts service personnel working on it in danger from moving vehicles that enter the work area. To help prevent this safety hazard, secure the area by using a service truck (or some other vehicle) to block access to the work area.

⚠ WARNING: All wiring must enter the console's enclosure through the designated knockouts. An explosion hazard may result if other openings are used. All wiring from probes to the console must be run in conduit separate from all other wiring. Failure to do so will create an explosion hazard.

⚠ DANGER: Make sure you check the installation location for potential ignition sources such as flames, sparks, radio waves, ionizing radiation, and ultrasound sonic waves. If you identify any potential ignition sources, you must make sure safety measure are implemented.

Programming and operation documentation

The *EVO™ 200 and EVO™ 400 Automatic Tank Gauges Operation Guide* and the *EVO™ 200 and EVO™ 400 Automatic Tank Gauges Programming Guide* are useful manuals you may need. To download these manuals, go to: www.franklinfueling.com>Products>Fuel Management Systems>Automatic Tank Gauges>EVO™ 200 & EVO™ 400>Downloads>Manuals. Alternatively, you can click the following link, and go to the "Manuals" heading:

<http://www.franklinfueling.com/americas/fms/featured/27308/en/evo-200-evo-400#Downloads>

Certified installer or service person

The equipment described in this manual should be serviced only by an FFS-certified technician, installer, or service person. Only an FFS-certified technician, installer, or service person is allowed to access both the user interface keypad and internal areas of an EVO™ 200 or EVO™ 400 ATG.

Station owner or operator

Only the station owner or operator is allowed access to the user interface keypad. Access to internal areas of the EVO™ 200 or EVO™ 400 ATG console is strictly prohibited.

Abbreviations and acronyms

AST - Aboveground Storage Tank
ATG - Automatic Tank Gauge
FMS - Fuel Management Systems
IS - Intrinsically Safe
PC - Personal Computer
RLY - Relay Module
TPI - Turbine Pump Interface
UST - Underground Storage Tank

Product description

EVO™ 200 and EVO™ 400 ATGs are complete, automatic, continuous monitoring systems that:

- Perform inventory monitoring.
- Generate reports automatically in response to preset and programmed conditions and alarms.
- Provide audio-visual indications when an alarm or warning condition exists.

- Perform tank reconciliation and autocalibration.
- Print reports on an external USB printer.
- You can access remotely via Ethernet or RS-232 with a web browser.
- Perform leak detection and density monitoring.

Specifications

The specifications for an EVO™ 200 or EVO™ 400 ATG are:

- Line voltage: 110-240 V~, 1.0 A.
- Frequency and power: 50/60 Hz, 100 W maximum.
- Storage temperature: -20 to 60° C (-4 to 140° F).
- Operating temperature: 0 to 40° C (32 to 104° F).
- Operating humidity: 0 to 95%, non-condensing.
- Exterior cleaning: Cloth or sponge slightly dampened in mild detergent.
- Splash resistance: Not to be exposed to direct spray, splash or drips.
- Location: Indoors in a non-hazardous, pollution degree 2 environment per IEC60664.
- Relay rating: 2A @ 240V~.

goind.com.au

Console Installation

Console location

Install the console indoors in an area that has a pollution degree 2 rating and is classified as non-hazardous (per IEC60664). Place the console at eye level, for convenience, on a level, vertical surface 2–6' (0.6–1.9 m) high. Use appropriate fasteners.

Mounting the console

Removing the cover

⚠ WARNING: Mount the console in a location where explosive or flammable vapors are not present. Otherwise, there is an explosion hazard that can result in property damage, environmental contamination, severe injury, and death.

IMPORTANT: Leave at least 2" (50 mm) of open space around the console to allow for ventilation, communication port connections, conduit, and wiring. Allow at least 7" (175 mm) at the top if the unit has an antenna.

To remove the cover, press the cover release tabs in and lift the cover straight away from the unit with two hands. To reinstall the cover, place it straight on the unit to help avoid damaging the LED light pipes.



Two mounting screw holes are located on each side of the console housing. Use fasteners that have sufficient load carrying capacity and are appropriate for wall construction. Make sure that there is enough room around the console for conduit, communication port connections, probe wiring, and access.

Standard installation materials

Select and install standard installation materials according to local, state, and federal codes that govern the installation of this product and its associated systems. See the console, module wiring, or associated devices section of this manual for details.

Circuit breaker

The console has a 20 Amp circuit breaker that provides power for only the console.

Weatherproof junction boxes

There must be a weatherproof junction box (16 inch³ (406.4 mm³) minimum), cover, and cover gasket for liquid level probe manholes. Also use ½" (16 mm) bushings for probe compression fittings. Use a weatherproof metal pull box for combining multiple circuits that run into the console through one or more conduits. Use a separate weatherproof metal pull box to combine intrinsically safe (IS) liquid level probe wiring. Do not run other non-intrinsically safe wiring into the IS pull box. Run 0.5" (16 mm) IS probe conduit from the manholes to the IS pull box, and then run one or two 0.5" (16 mm) conduits to the console's IS conduit knockouts.

Conduit

Entryways into the console are sized for 1" (27 mm) conduit. If you want to use smaller conduit, make sure you use the appropriate size reducing washers. Use conduit hardware that is appropriate for the installation and meets local, state, and federal requirements.

Splice connector kit warranty requirement

IMPORTANT: According to the FFS warranty, you must use splice connector kits.

Use the FFS-approved, moisture-resistant, no-strip splice connectors for liquid level probes. (Part number TSP-KW30 contains 30 FFS-approved connectors.)

Moisture-resistant splice connectors

Using moisture-resistant splice connectors will:

- Reduce or eliminate corrosion of the wire connections from repeated exposure to water condensation, which causes eventual signal loss and system failure.
- Reduce or eliminate equipment damage from water flooding around the connectors, which causes short-circuit damage.

Thread sealant (UL classified)

Use a non-hardening, stay-soft, gasoline compatible, thread sealant to seal and waterproof all tank riser pipe threads. Also, the thread sealant (or pipe dope, as it is commonly known) should also be chemically non-reactive to the product in the tank(s). Apply thread sealant to seal and waterproof all outdoor electrical conduit fitting threads, including the hole plugs at the weatherproof junction boxes.

Riser pipes

ANSI Schedule 40- (or chemically non-reactive) 2 or 4 inch (50.8 or 101.6 mm) (8 NPT) riser pipes for liquid level probes.

Cables required for liquid level probes and 4-20 mA sensors

Use cables and wires compliant with national and local codes. FFS recommends using the types of cable shown below up to a recommended length of:

- Belden™ No. 87760 (0.15" or 3.81 mm OD) to 260 feet (80 m)
- Belden™ No. 87761* (0.12" or 3.048 mm OD) to 400 feet (120 m)
- Belden™ No. 89182* (0.31" or 7.874 mm OD) to 1500 feet (450 m)

* You can order this cable from FFS.

NOTE: Conductors of different IS circuits that are run together in the same conduit should have at least .01" (.25 mm) of insulation.


Cable or wire for 2-wire sensors

You can use 2-wire sensor wire (type THHN, TFFN, or THWN, gas and oil resistant, 18 AWG minimum, 1500 feet maximum wire run length) when it is enclosed in rigid metal conduit from the sensor to the console.

When cable is not run through rigid metal conduit, you must use leak detection sensor cable. (See the *Direct Burial Cable Installation Manual* (FFS part number 000-1041) for further information.) The following are cable types and descriptions:


- Alpha 58411 (FFS part number 600-0062):
 - 2-conductor cable for standard, 2-conductor, leak detection sensors (0.114 inch (2.9 mm) OD).
- Wire required for the EVO™ TS-550 or EVO™ 5000 console:
 - Power: 3 conductor—12 GA to 14 GA maximum; Black, white, and green.
 - Safety ground—1 conductor: 12 AWG green. (Two may be required in some locations.)
 - Accessories: As required—Type THHN, TFFN, or THWN; 18 AWG minimum.

Console dimensions

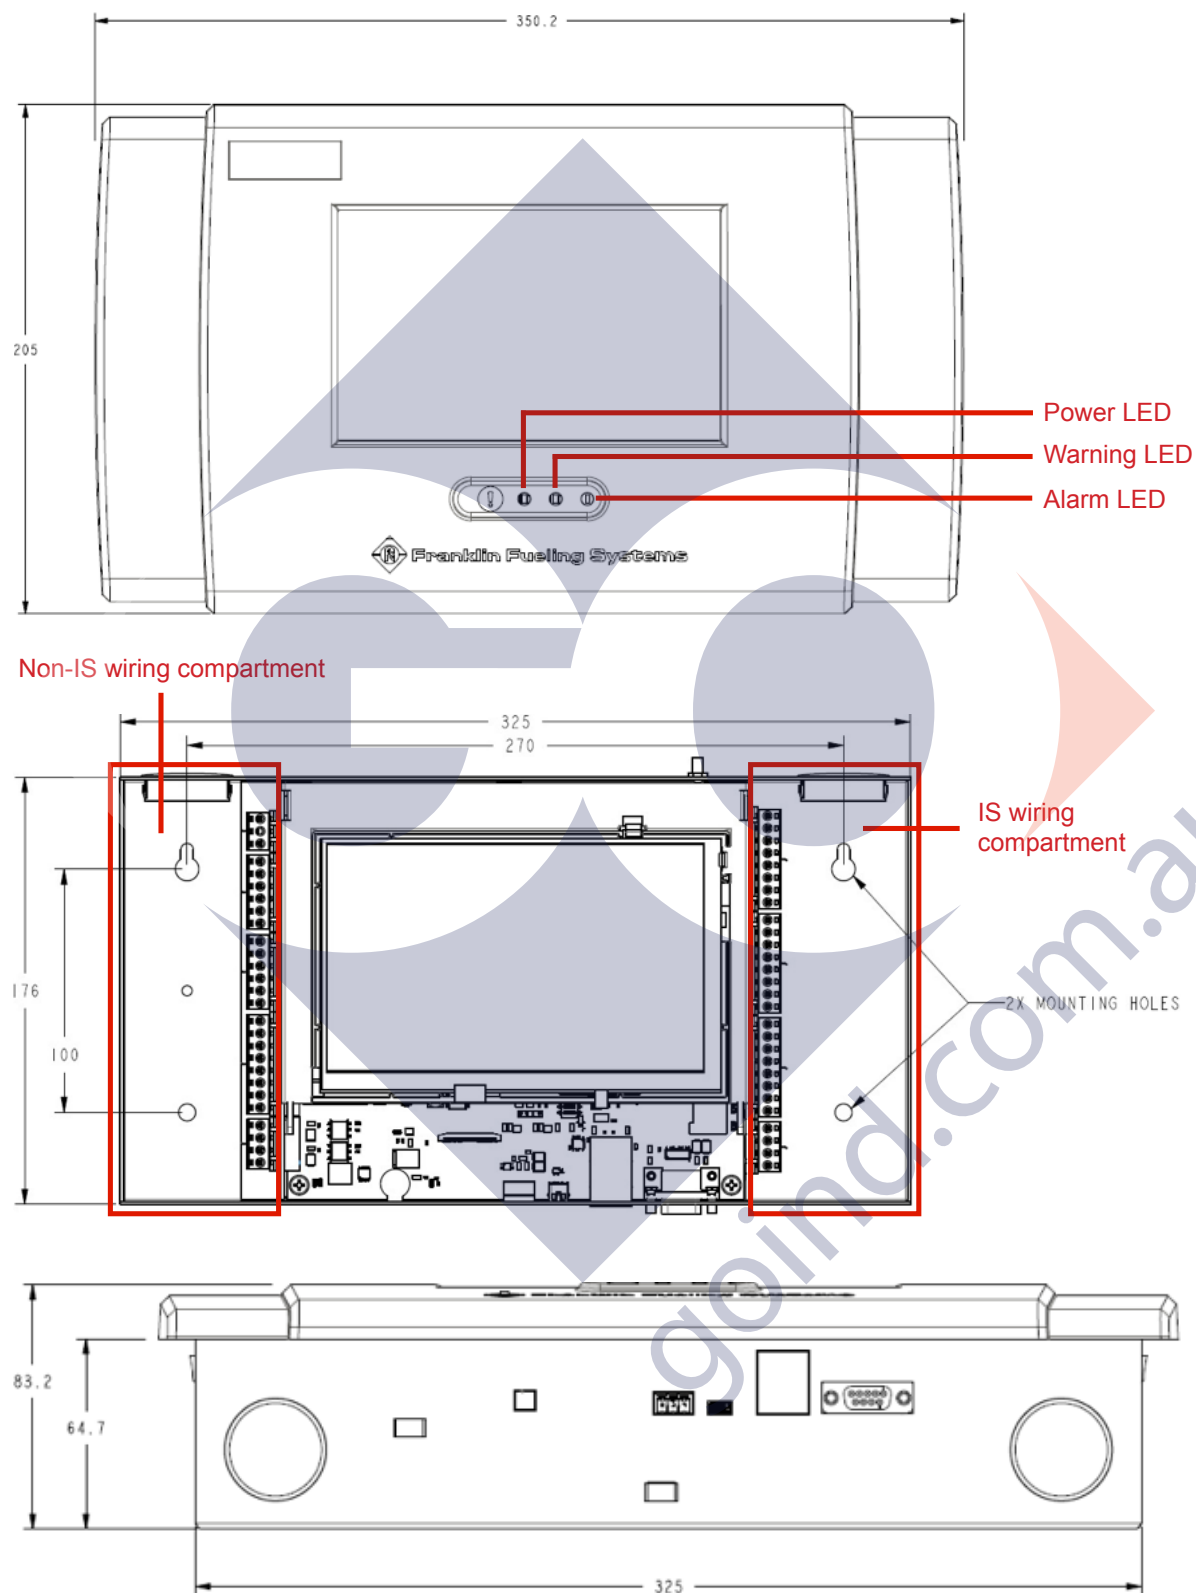

Wiring the console

Intrinsically safe wiring

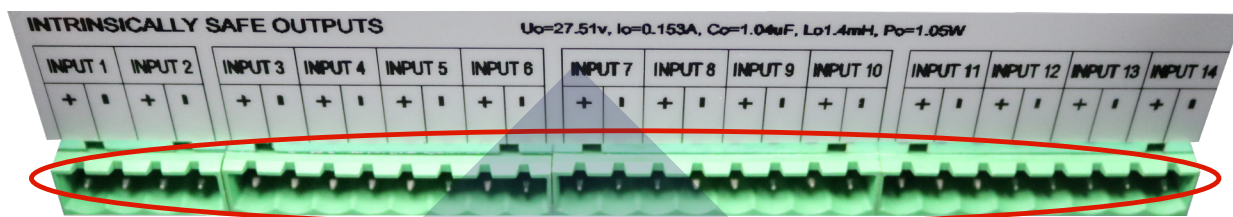

Intrinsically safe outputs

IMPORTANT: Do not run IS and non-IS wiring in the same conduit.

IMPORTANT: If local codes do not require you to use conduit, you must use cable glands at all enclosure knock-outs. Gaps larger than 0.06" (1.5 mm) violate safety approvals. Make sure you provide adequate IS and non-IS wire separation.

IMPORTANT: To avoid violating safety approvals, make sure you install connectors in unused intrinsically safe output receptacles.

The IS inputs are certified as associated apparatuses by the Entity Concept. Under this concept, the IS apparatus (field device) has assigned parameters that, when matched to those of an associated apparatus, constitute an IS system. If none are available, use the following values:

- 60 pF/foot (200 pF/m) for capacitance for each wire pair.
- 0.2 uH/foot (0.7 uH/m) for inductance for each wire pair.

Refer to the apparatus's control drawing for cable run length calculations. Associated apparatus parameter types and comparisons to IS apparatus parameter values are in the following table:


Parameter	Associated Apparatus	Comparison	IS Device
Maximum Voltage	U_o	$<$	U_i
Maximum Current	I_o	$<$	I_i
Maximum Power	P_o	$<$	P_i
Total unprotected capacitance	C_o	$>$	$C_i + C_c$
Total unprotected inductance	L_o	$>$	$L_i + L_c$

Terms

Term	Definition	Term	Definition
U_o	Maximum output voltage	C_o	Maximum external capacitance
U_i	Maximum input voltage	C_i	Maximum internal capacitance
I_o	Maximum output current	C_c	Cable capacitance
I_i	Maximum input current	L_o	Maximum external inductance
P_o	Maximum output power	L_i	Maximum internal inductance
P_i	Maximum input power	L_c	Cable inductance

UDP probe and sensor wiring

The probe and sensor wiring is IS and is kept separate from all other wiring. Conduit must enter the console enclosure through only the designated knockouts. The installation may require the conduit to enter on top or bottom. Do not lose the conduit plugs, and make sure any openings are covered by the plugs. Attach the probe wiring as shown below:

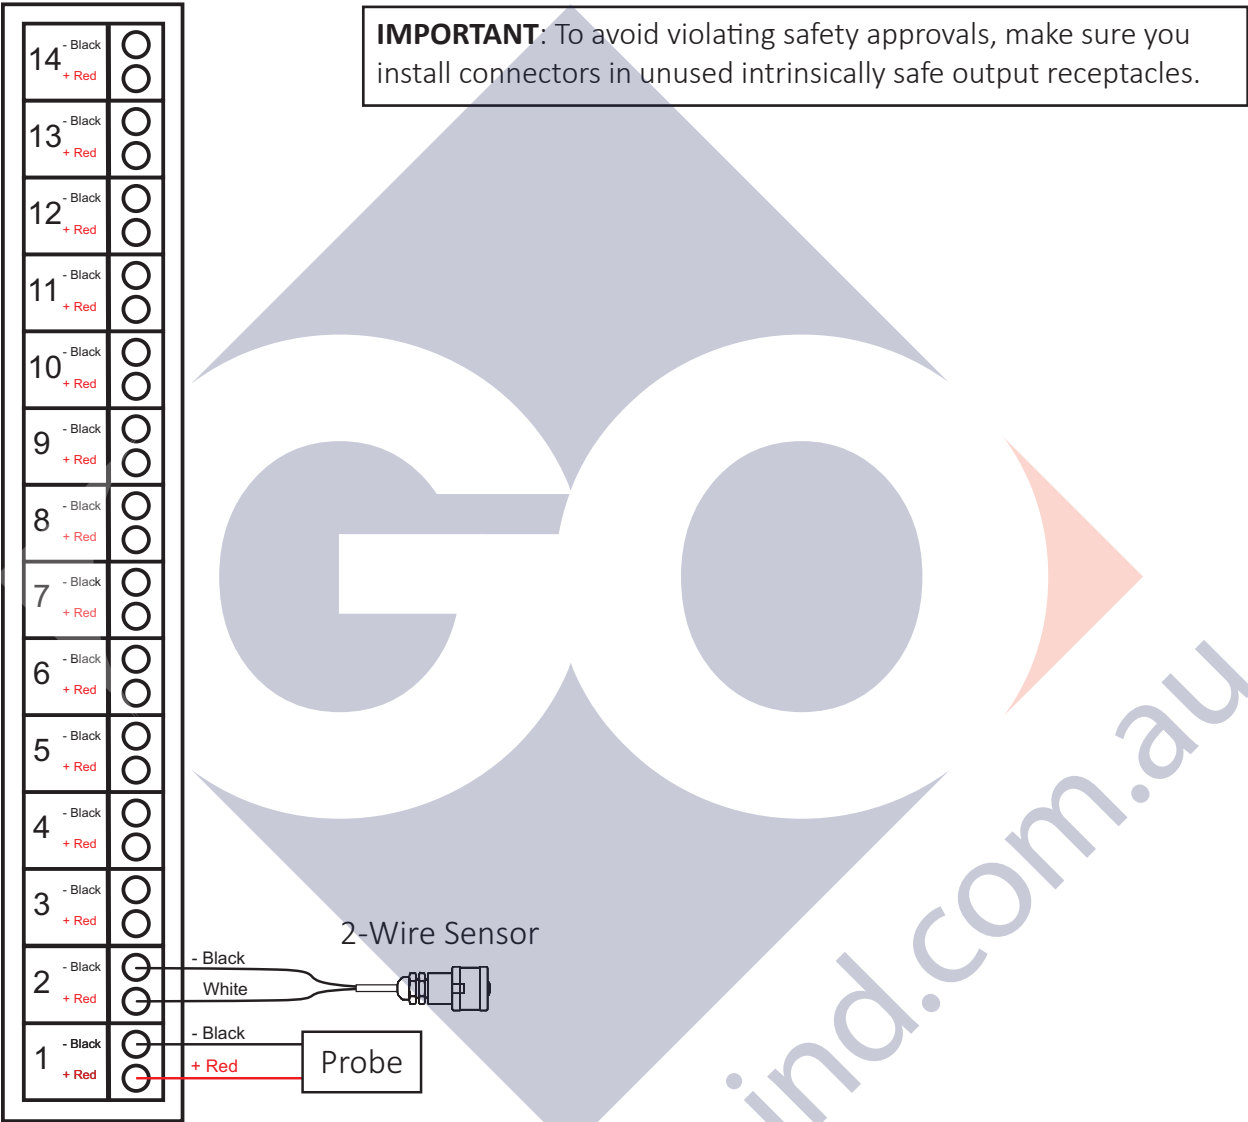

IMPORTANT: To avoid violating safety approvals, make sure you install connectors in unused intrinsically safe output receptacles.

UDP 24 V Input Specifications (Motherboard A, B, C)	
Number of Channels:	14, 6
Safety rating:	Class I, Division 1, Group D, [Ex ia] IIA
Entity parameters:	Uo = 27.5 V Io = 0.153 A Co = 1.04 uF Lo = 1.4 mH Po = 1.05 W

Cables required for liquid level probes

Use cables and wires compliant with national and local codes to help provide reliable communication between the console and probes. FFS recommends using the types of cable shown in the table below. Cables must be oil and water resistant, 22 AWG (or greater), and must be shielded, twisted pairs.

Distance feet (m)	Capacitance (pF) per foot	Inductance (μH) per foot	Belden™ Cable
500 (152)	<100	<0.2	87760 87761* 88760
1000 (305)	<60	<0.2	8760 8770
1500 (457)	<20	<0.3	89182*

* You can order this cable from FFS.

Line power wiring


Non-intrinsically safe wiring

⚠ WARNING: Always lock out and tag electrical circuit breakers while installing or servicing this equipment and any related equipment. A potentially lethal electrical shock hazard and the possibility of an explosion or fire from a spark can result if the electrical circuit breakers are accidentally turned on during installation or servicing.

Console power supply

Power to the console must be 110-240 VAC, 50/60 Hz. At the electrical power panel, use a 20 amp circuit breaker that supplies power to only the console.

IMPORTANT: Do not connect other equipment to this circuit.



⚠ WARNING: The ground bus in the electrical panel must be connected to an earth ground as required by the National Electrical Code (or Canadian Electrical Code) when applicable. If the ground bus is not properly connected to an earth ground, or if the IS safety ground is not properly connected at the console, a dangerous condition will be created that could result in an explosion.

Check electrical resistance to earth ground



After wiring the IS safety grounds, check the resistance between the IS safety ground terminals at the console and the earth ground. This resistance must be less than 1 ohm.

110/240 VAC line power wire connections

Electrical Panel	No. Conductors, Color (Gauge)	Circuit
20 Amp Circuit Breaker	1 Black wire, 14 AWG (1.6 mm) min.	110/240 VAC Power
Neutral	1 White Wire, 14 AWG (1.6 mm) min.	Neutral
Ground Bus	1 Green wire, 14 AWG (1.6 mm) min.	Ground
Ground Bus	1 Green wire, 12 AWG (2.1 mm) min.	Safety Ground


Console Ground Connection

Attach the ground wire to the grounding stud in the left compartment of the console.

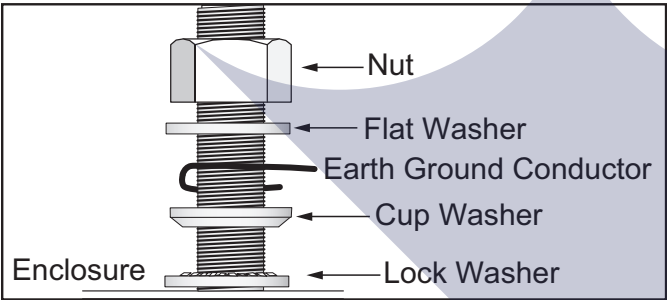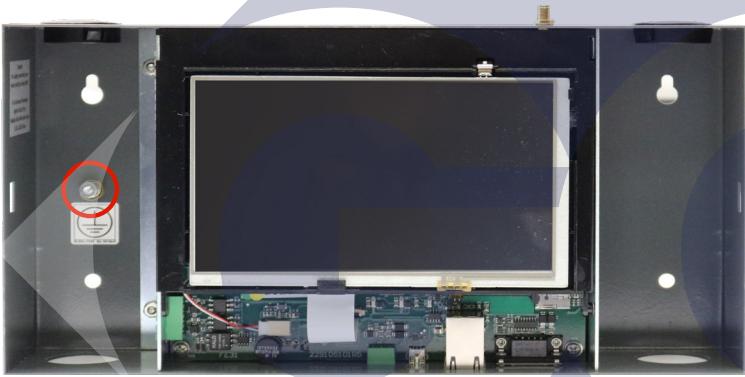

Communication ports

The console has several communication ports that can be used to communicate with devices or connect to a local area network, point-of-sale device, external printer, or modem.

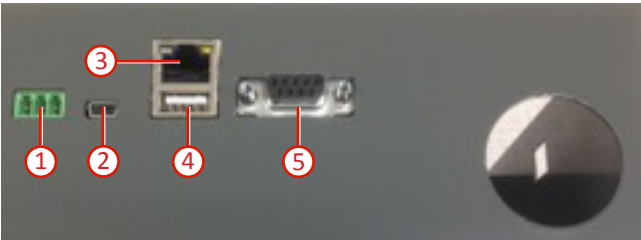

#	Port	Connector Type	Devices
1	RS-485	Pluggable terminal block	TPI/FE Petro Smart Controllers
2	Micro-USB	Female micro-USB	Local network or computer
3	Ethernet	RJ-45	Local network or computer
4	USB	Type A	External printer, modem, or USB flash drive*
5	RS-232 Comm 1	DB9 female	Modem, POS, or local PC

* A USB flash drive can be used to collect data or load upgraded files.

RS-232 communication connectors

A connector for RS-232 interface is on the bottom of the console. The following are the pin designations for this connector:



Female


Console RS-232 Comm Port 1
DB9 Connector, Female, DCE

Pin No.	Function	Input/Output
2	TD	O →
3	RD	I ←
5	GND	

NOTE: Pins 1, 4, and 6-9 are not connected.

RS-485 communication connectors


One connector for RS-485 interface is provided on the bottom of the console. The pin designations for the RS-485 connectors are as follows:



1 2 3

Pin No.	Function
1	A
2	B
3	GND

Relay wiring

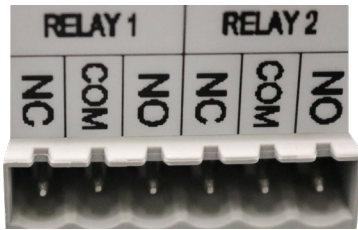


Relay	Terminal	Description
1	1.	Normally Closed
	2.	Common
	3.	Normally Open
2	4.	Normally Closed
	5.	Common
	6.	Normally Open
3	1.	Normally Closed
	2.	Common
	3.	Normally Open
4	4.	Normally Closed
	5.	Common
	6.	Normally Open

NOTE: There can be 0, 2, or 4 relays.

Dry contact wiring



Dry contacts

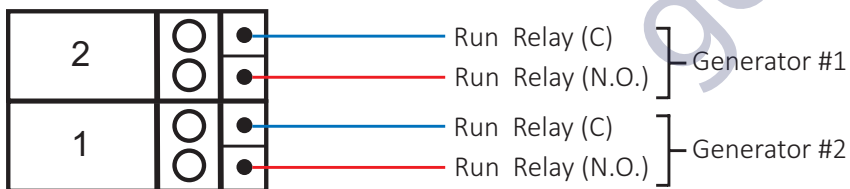

NOTE: Dry contacts are internally wetted with 5 VDC, 15 mA DC. External relays should have contacts suitable for low current.

NOTES:

1. THE MODEL UDRPA-C) SHALL NOT BE CONNECTED TO ANY EQUIPMENT WHICH USES OR GENERATES GREATER THAN 250V.
2. EACH GROUND TERMINAL SHALL BE CONNECTED TO A SUITABLE SYSTEM EARTH GROUND. THE DC RESISTANCE BETWEEN GROUND TERMINALS AND EARTH GROUND SHALL BE LESS THAN 1 OHM.
3. THE MODEL UDRPA-C) WIRING SHALL BE INSTALLED IN ACCORDANCE WITH THE NEC AND APPLICABLE NATIONAL OR LOCAL CODES. CONDUCTORS OF DIFFERENT INTRINSICALLY SAFE CIRCUITS RUN IN THE SAME CABLE CONDUIT MUST HAVE AT LEAST 0.25mm OF INSULATION.
4. CAPACITANCE AND INDUCTANCE OF THE FIELD WIRING FROM THE INTRINSICALLY SAFE EQUIPMENT TO THE BARRIER SHALL BE CALCULATED AND MUST BE INCLUDED IN THE SYSTEM CALCULATIONS AS SHOWN IN THE DIAGRAM TO THE RIGHT. CABLE CAPACITANCE (C_{cab}) PLUS INTRINSICALLY SAFE EQUIPMENT CAPACITANCE (C_i) MUST BE LESS THAN THE MARKED CAPACITANCE (C_o) SHOWN ON ANY BARRIER USED. THE SAME APPLIES FOR INDUCTANCE (L_i, L_{cable} AND L_o, RESPECTIVELY), WHERE THE CABLE CAPACITANCE AND INDUCTANCE PER FOOT ARE NOT KNOWN, THE FOLLOWING VALUES SHALL BE USED: C_{cab}=60pF/ft (200pF/m), L_{cable}=0.24H/ft (0.74H/m).
5. WIRING, CABLEING AND SEALS MUST BE INSTALLED IN ACCORDANCE WITH THE NEC, CEC OR OTHER APPLICABLE NATIONAL OR LOCAL CODES.
6. USE ONLY A CABLE THAT IS SPECIFIED IN THE USER INSTALLATION MANUAL OR LISTED EQUIVALENT FOR THE INSTALLATION OF LIQUID LEVEL PROBES.
7. USE THE FOLLOWING WIRE TYPES ONLY: 18 AWG MINIMUM TO CONNECT SENSORS TO THE UDRPA-C) ASSOCIATED APPARATUS, OIL AND GASOLINE RESISTANT TYPES.
8. USE ONLY GRIMP OR INSULATION DISPLACEMENT TYPE CONNECTORS FOR ELECTRICAL CONNECTIONS (DO NOT USE WIRE NUTS OR OTHER TYPE CONNECTORS).
9. SEAL ALL FIELD WIRING CONNECTIONS FROM MOISTURE.
10. SEE INSTALLATION MANUAL FOR MORE DETAIL.
11. THE GENERAL CONTRACTOR MUST SUPPLY THE SPECIFIED WIRE, CONDUITS AND ELECTRICAL ACCESSORIES.
12. THE ENTRY CONCEPT ALLOWS THE USER TO IDENTIFY ACCEPTABLE COMBINATIONS OF INTRINSICALLY SAFE APPARATUS AND ASSOCIATED APPARATUS THAT HAVE NOT BEEN EXAMINED AS A SYSTEM. EACH APPARATUS IS EXAMINED INDIVIDUALLY AND THEN THE COMBINATIONS OF APPARATUS ARE EXAMINED AND ASSIGNED A SET OF PARAMETERS CALLED ENTRY PARAMETERS. THE ENTRY PARAMETERS FOR UDRPA-C) (ASSOCIATED APPARATUS) CAN BE FOUND IN THE DIAGRAM TO THE RIGHT TO DETERMINE THE (V_{max} (U), I_{max} (U), C_i L_i AND P_i VALUES. THE CONTROL DRAWING FOR THE INTRINSICALLY SAFE APPARATUS SHALL BE USED. THE COMBINATION OF THE INTRINSICALLY SAFE APPARATUS AND ASSOCIATED APPARATUS MUST COMPLY WITH THE FOLLOWING:

$U_o (Voc) \leq U_i (Vmax)$
 $I_o (Is) \leq I_i (Imax)$
 $P_o \leq P_i (Pmax)$
 $C_o (Ca) \geq C_i + C_{cable}$ (SEE NOTE 4)
 $L_o (La) \geq L_i + L_{cable}$ (SEE NOTE 4)

NON-INTRINSICALLY SAFE COMPARTMENT

INTRINSICALLY SAFE COMPARTMENT

NON-HAZARDOUS LOCATION

HAZARDOUS LOCATION

CLASS 1, DIV. 1, GROUP D

TO INTRINSICALLY SAFE APPARATUS

OR SIMPLE APPARATUS

MODEL UDRPA-B,C) ASSOCIATED APPARATUS EACH TERMINAL PAIR +, -

$U_o = 27.51Vdc$
 $I_o = 0.153 A$
 $L_o = 1.04uH$
 $P_o = 1.05W$

DEVICE N } DR SIMPLE APPARATUS

CONTROL DRAWING 228180006 SHIPPED WITH PRODUCT WILL HAVE DEDICATED PAGE REPRODUCING ALL ABOVE INFORMATION AND THE NOTE:

ONLY THIS PAGE REPRESENTS UL CONTROL DRAWING FOR THE UNITED STATES AND CANADA. ADDITIONAL PAGES OF THIS DOCUMENT REPRESENT SIMILAR INFORMATION FOR ALTERNATE COUNTRIES OR CERTIFICATIONS.

20. WARNING:
ASSOCIATED APPARATUS NON HAZARDOUS LOCATION PROVIDES INTRINSICALLY SAFE CIRCUITS FOR SENSORS LOCATED IN CLASS 1, DIV. 1, GROUP D HAZARDOUS LOCATIONS WHEN INSTALLED PER CONTROL DRAWING 228180006. SEE INSTALLATION INSTRUCTIONS.

21. WARNING:
THIS UNIT HAS MORE THAN ONE POWER SUPPLY CONNECTION POINT. DISCONNECT ALL POWER SUPPLIES BEFORE SERVICING.

22. WARNING:
CETTE UNIT A PLUS DUN POINT DE D'ALIMENTATION, DÉBRANCHEZ TOUTES LES ALIMENTATIONS ÉLECTRIQUES AVANT L'ENTRETIEN.

23.
THE ASSOCIATED APPARATUS MAY ALSO BE CONNECTED TO SIMPLE APPARATUS AS DEFINED IN ARTICLE 504.2 IN ACCORDANCE WITH ARTICLE 504.1 (B) OF THE NATIONAL ELECTRICAL CODE (ANSI/NFPA 70), OR OTHER LOCAL CODES, AS APPLICABLE.

24. WARNING:
AVERTISSEMENT: LA SUBSTITUTION DES COMPOSANTS PEUT NUIRE À LA SÉCURITÉ INTRINSÈQUE. POUR ÉVITER L'IGNITION DE MATIÈRES INFLAMMABLES OU COMBUSTIBLES, DÉBRANCHEZ L'ALIMENTATION AVANT L'ENTRETIEN.

UL LISTED 6L79

[Exia]

EX CERTIFIED PRODUCT
-RELATED DOCUMENT-
NO MODIFICATIONS PERMITTED WITHOUT APPROVAL FROM THE AUTHORIZED PERSON

THE INFORMATION CONTAINED IS THE PROPERTY OF FRANKLIN FUELING SYSTEMS, AND IS FOR THE EXCLUSIVE USE OF THE USER. THE REPRODUCTION OF THIS DOCUMENT WITHOUT THE WRITTEN PERMISSION OF FRANKLIN FUELING SYSTEMS IS PROHIBITED.

REVISIONS			
REV	DESCRIPTION	DATE	BY
1	INITIAL RELEASE	10/10/17	719385
2	INCREASE LEGIBILITY WHEN PRINTED	12/15/17	720653

UL LISTED 6L79			
MODEL	UL LISTED	UL LISTED	UL LISTED
228180006	228180006	228180006	228180006

CONTROL DRAWING EVD (UL)

228180006

1 of 2

Control drawing 2

NOTES:

1. THE MODEL UDPA-F, ANA-A, B, C, 485/D-E, F, SHALL NOT BE CONNECTED TO ANY EQUIPMENT WHICH USES OR GENERATES GREATER THAN 250V.
2. EACH GROUND TERMINAL SHALL BE CONNECTED TO A SUITABLE SYSTEM EARTH GROUND. THE DC RESISTANCE BETWEEN GROUND TERMINALS AND EARTH GROUND SHALL BE LESS THAN 1 OHM.
3. CAPACITANCE AND INDUCTANCE OF THE FIELD WIRING FROM THE INTRINSICALLY SAFE EQUIPMENT TO THE BARRIER SHALL BE CALCULATED AND MUST BE INCLUDED IN THE SYSTEM CALCULATIONS AS SHOWN IN THE DIAGRAM TO THE RIGHT. CABLE CAPACITANCE (C_{cab}) PLUS INTRINSICALLY SAFE EQUIPMENT CAPACITANCE (C_i) MUST BE LESS THAN THE MARKED CAPACITANCE (C_o) SHOWN ON ANY BARRIER USED. THE SAME APPLIES FOR INDUCTANCE (L_i, L_{cab} AND L_o RESPECTIVELY), WHERE THE CABLE CAPACITANCE AND INDUCTANCE PER FOOT ARE NOT KNOWN, THE FOLLOWING VALUES SHALL BE USED: C_o=609pF/ft (200pF/m), L_o=0.24mH/ft (0.74H/m).
4. WIRING, CABLING AND SEALS MUST BE INSTALLED IN ACCORDANCE WITH THE APPLICABLE NATIONAL OR LOCAL CODES.
5. SEE INSTALLATION MANUAL FOR MORE DETAIL.
6. THE ENTRY CONCEPT ALLOWS THE USER TO IDENTIFY ACCEPTABLE COMBINATIONS OF INTRINSICALLY SAFE APPARATUS AND ASSOCIATED APPARATUS THAT HAVE NOT BEEN EXAMINED AS A SYSTEM. EACH APPARATUS IS EXAMINED SEPARATELY BY AN ATEX NOTIFIED BODY AND ASSIGNED A SET OF PARAMETERS CALLED ENTRY PARAMETERS. THE ENTRY PARAMETERS FOR UDPA-F, ANA-A, B, C, 485/D-E, F (ASSOCIATED APPARATUS) CAN BE FOUND IN THE DIAGRAM TO THE RIGHT. TO DETERMINE THE n, n₁, C₁, L₁ AND P₁ VALUES THE CONTROL DRAWING FOR THE ASSOCIATED APPARATUS SHALL BE USED. THE COMBINATION OF THE INTRINSICALLY SAFE APPARATUS AND ASSOCIATED APPARATUS MUST COMPLY WITH THE FOLLOWING:
 $U_o < U_i$
 $I_o \leq I_i$
 $P_o \leq P_i$
 $C_o \leq C_i + C_{cable}$ (SEE NOTE 3)
 $L_o \leq L_i + L_{cable}$ (SEE NOTE 3)
7. THE OUTPUT CURRENT OF THIS ASSOCIATED APPARATUS IS LIMITED BY A RESISTOR SUCH THAT THE OUTPUT VOLTAGE-CURRENT PILOT IS A STRAIGHT LINE DRAWN BETWEEN OPEN-CIRCUIT VOLTAGE AND SHORT-CIRCUIT CURRENT.
8. ASSOCIATED APPARATUS MUST BE INSTALLED IN AN ENCLOSURE SUITABLE FOR THE APPLICATION IN ACCORDANCE WITH THE NATIONAL AND LOCAL CODES, AS APPLICABLE.
9. INTRINSICALLY SAFE CIRCUITS MUST BE WIRED AND SEPARATED IN ACCORDANCE WITH NATIONAL AND LOCAL CODES, AS APPLICABLE.
10. THIS ASSOCIATED APPARATUS HAS NOT BEEN EVALUATED FOR USE IN COMBINATION WITH ANOTHER ASSOCIATED APPARATUS.


NON-INTRINSICALLY SAFE COMPARTMENT

INTRINSICALLY SAFE COMPARTMENT

NON HAZARDOUS LOCATION

HAZARDOUS LOCATION

GROUP IIA, ZONE 0

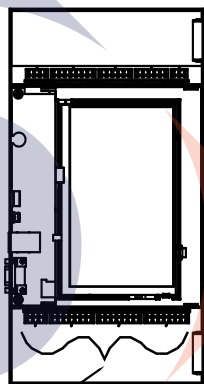

MODEL UDPA-B,C
ASSOCIATED APPARATUS
EACH TERMINAL PAIR +, -

U_o = 27.5V VDC
I_o = 0.153 A
C_o = 104uF
L_o = 1.4 mH
P_o = 105W

DEVICES N } TO INTRINSICALLY SAFE APPARATUS
DEVICE 1 } OR SIMPLE APPARATUS

11. ATEX/IECEx APPROVAL DISPLAYED:

CE 0539 Ex II (D) G
IECEx UL 17.0059
IECEx Gd IIA
DENKO I/7 ATEX 1902

12. ALL OF THE ABOVE INFORMATION CAN BE COMBINED INTO A CONTROL DRAWING WITH OTHER CERTIFICATIONS OR IN THE INSTALLATION INSTRUCTIONS IN ANY PRODUCT.
13. THE ASSOCIATED APPARATUS MAY ALSO BE CONNECTED TO SIMPLE APPARATUS AS DEFINED IN ARTICLE 504.2 AND INSTALLED AND TEMPERATURE CLASSIFIED IN ACCORDANCE WITH ARTICLE 504.10(B) OF THE NATIONAL ELECTRICAL CODE (ANSI/NFPA 70), OR OTHER LOCAL CODES, AS APPLICABLE.

EX CERTIFIED PRODUCT
-RELATED DOCUMENT-
NO MODIFICATIONS PERMITTED
WITHOUT APPROVAL FROM THE
AUTHORIZED PERSON

THE INFORMATION CONTAINED IN THE PRESENT DRAWING IS THE PROPERTY OF FRANKLIN FUELING SYSTEMS AND IS NOT TO BE COPIED, USED OR REPRODUCED WITHOUT THE PERMISSION OF FRANKLIN FUELING SYSTEMS

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
2	SEE PAGE 1	-	-

UNITED STATES OF AMERICA NATIONAL FIRE PROTECTION ASSOCIATION STANDARD 504-2012 HAZARDOUS LOCATIONS CLASSIFICATION, MARKING, AND LABELING 1/10/2012			
	CONTROL DRAWING EVD (ATEX/IECEx)	228180006	2

Intentionally Blank



Intentionally Blank



Intentionally Blank





Franklin Fueling Systems

goind.com.au